




## Microwave System/ Target Infrastructure

Waqar Ahmed

University of Virginia (On behalf of Target group)

05 10 2021




## Microwave Rack

- Microwave slow control Rack power system.
  - 3 phase to 120v distribution is installed.
  - EIO Long HV cable tested and installed.
- Quantum Technology ORC
  - QT electrical wiring has been done.
  - LN2 Power distribution has been done.
  - QT electrical ORC has been submitted.
  - NMR Power supply schematic is under process.
- Control room rack
  - EIK remote panel installed



# Cable Trays/cable Placement

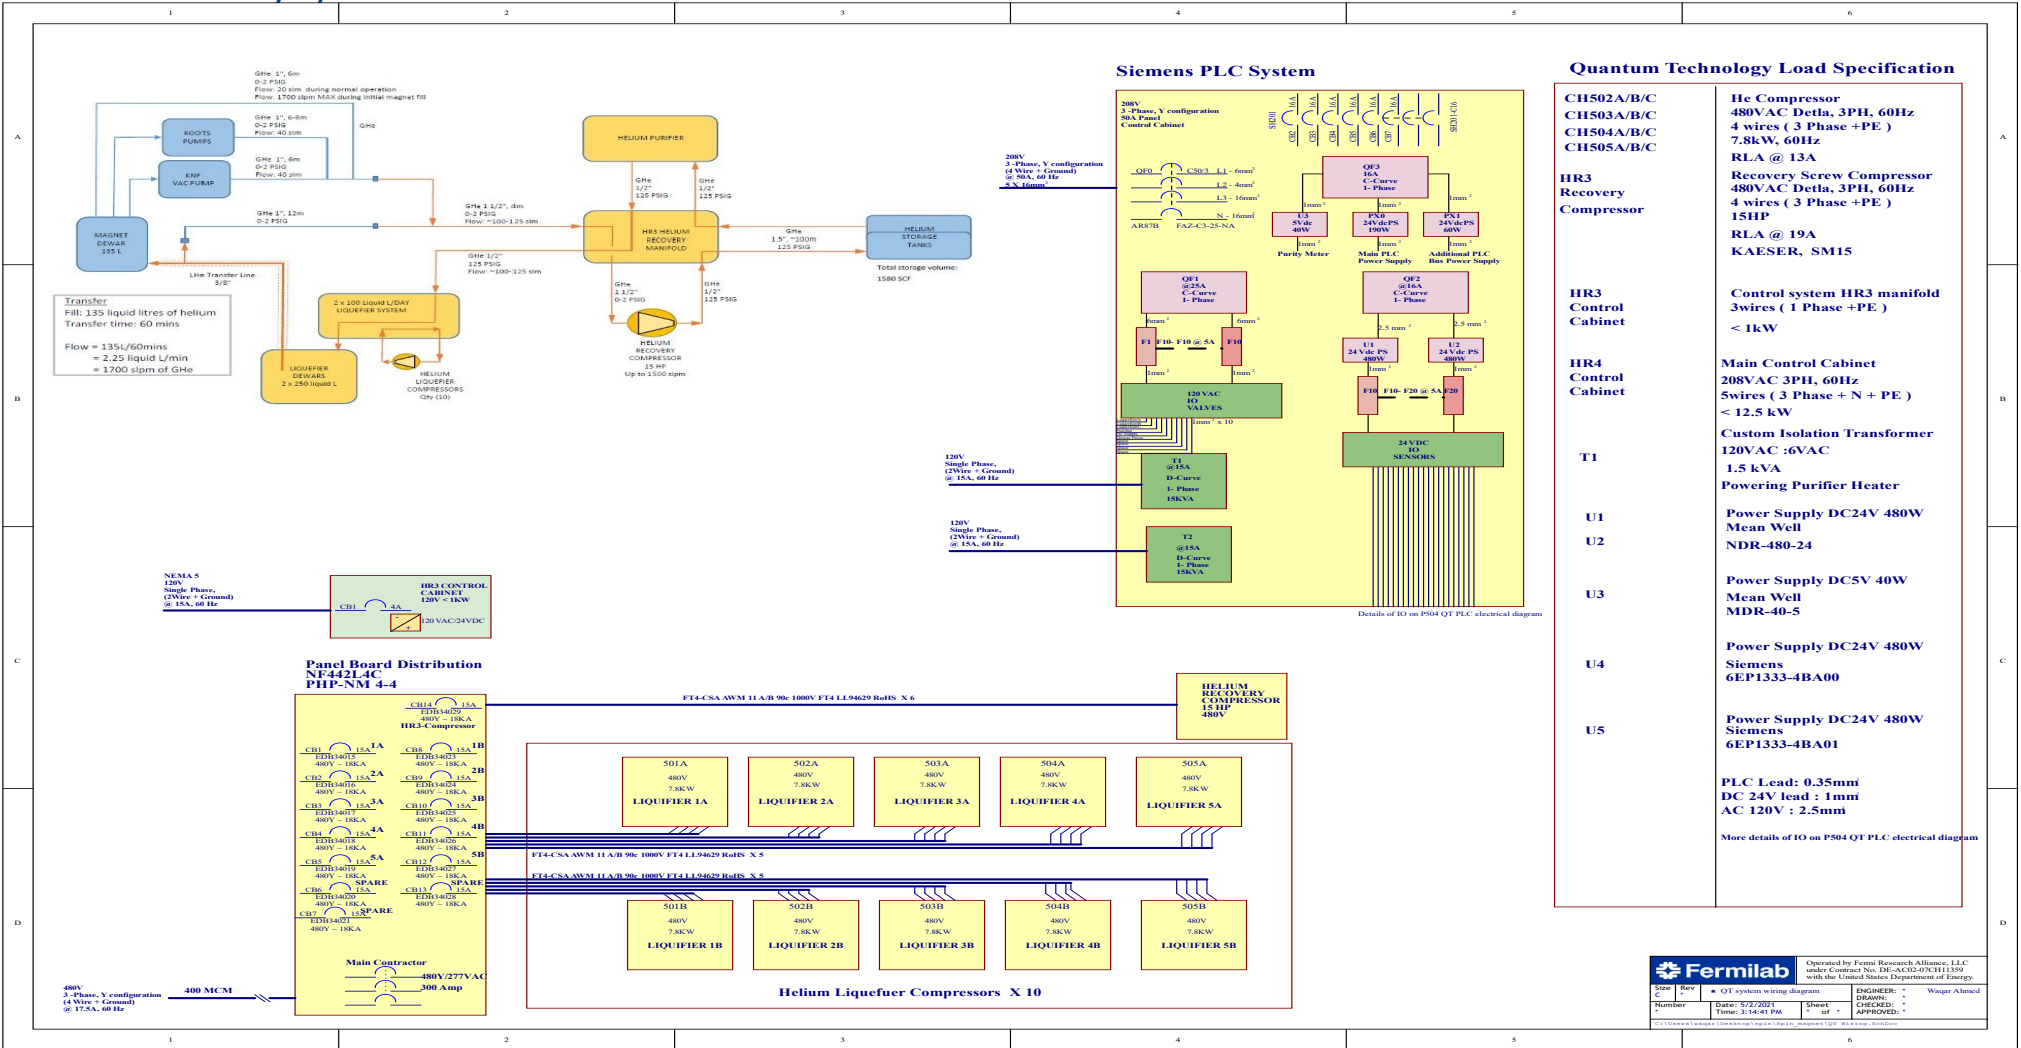

# NMR Power Supply

